### ENPHASE Q CABLE TERMINATOR

### Terminating the End of the Q Cable


Use the Enphase Q Cable Terminator to seal unused cable ends.

For full installation instructions for the Enphase IQ 6 and IQ 6+ Microinverters, read and follow all warnings and instructions in this guide and in the *Enphase IQ 6 and IQ 6+ Microinverter Installation and Operation Manual* at: <u>enphase.com/support</u>. Safety warnings are listed to the right of this guide.

A) Remove 13 mm (1/2'') of the cable sheath from the conductors. Use the terminator loop to measure.



- B) Slide the hex nut onto the cable. There is a grommet inside of the terminator body that should remain in place.
- C) Insert the cable into the terminator body so that each of the two wires land on opposite sides of the internal separator.

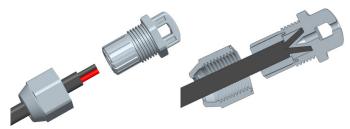

D) Insert a screwdriver into the slot on the top of the terminator to hold it in place, and tighten nut with 27 mm open-end wrench or channel lock pliers until fully tightened.



WARNING: Never unscrew the hex nut. Unscrewing the hex nut destroys the locking feature, and you must replace the terminator.


## Hold the terminator body stationary with the screwdriver and turn only the hex nut to prevent conductors from twisting out of the separator.

E) Manage the terminated cable end to the PV racking with a cable clip or tie wrap so that the cable and terminator do not touch the roof.

# SAFETY

#### IMPORTANT SAFETY INSTRUCTIONS. SAVE THIS INFORMATION.

This guide contains important instructions to follow during installation.

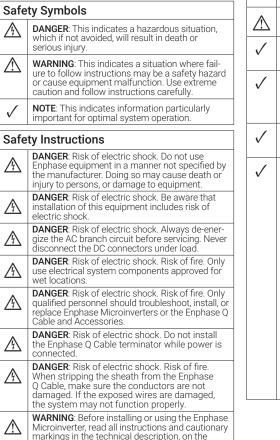

Enphase Microinverter System, and on the photo-

Enphase Customer Support: enphase.com/en-us/support/contact

voltaic (PV) equipment.

Safety Instructions Continued WARNING: Use the terminator only once. If you open the terminator following installation, the latching mechanism is destroyed. If the latching mechanism is defective, do not use the terminator. Do not circumvent or manipulate the latching mechanism. WARNING: When installing the Enphase O Cable. secure any loose cable to minimize tripping hazard NOTE: To ensure optimal reliability and to meet warranty requirements, install the cable terminator according to the instructions in this guide. NOTE: Perform all electrical installations in accordance with all applicable local electrical codes: the Canadian Electrical Code, part 1; and the National Electrical Code (NEC); ANSI requirements, and NFPA 70 NOTE: When looping the Enphase O Cable, do not form loops smaller than 4.75 inches (12 cm) in diameter. NOTE: When installing the Enphase Q Cable and accessories, adhere to the following: Do not expose the terminator or cable connections to directed, pressurized liquid (water jets, Do not expose the terminator or cable connections to continuous immersion. Do not expose the terminator or cable connections to continuous tension (e.g., tension due to pulling or bending the cable near the connection). Use only the connectors and cables provided. Do not allow contamination or debris in the connectors. Use the terminator and cable connections only when all parts are present and intact. Do not install or use in potentially explosive environments. Do not allow the terminator to come into contact with open flame. Fit the terminator using only the prescribed tools and in the prescribed manner. Use the terminator to seal the conductor end of the Enphase Q Cable; no other method is allowed.



